
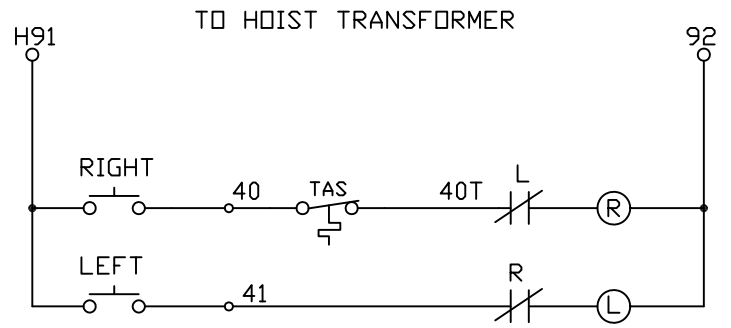


Go To Index

ELEMENTARY DIAGRAM

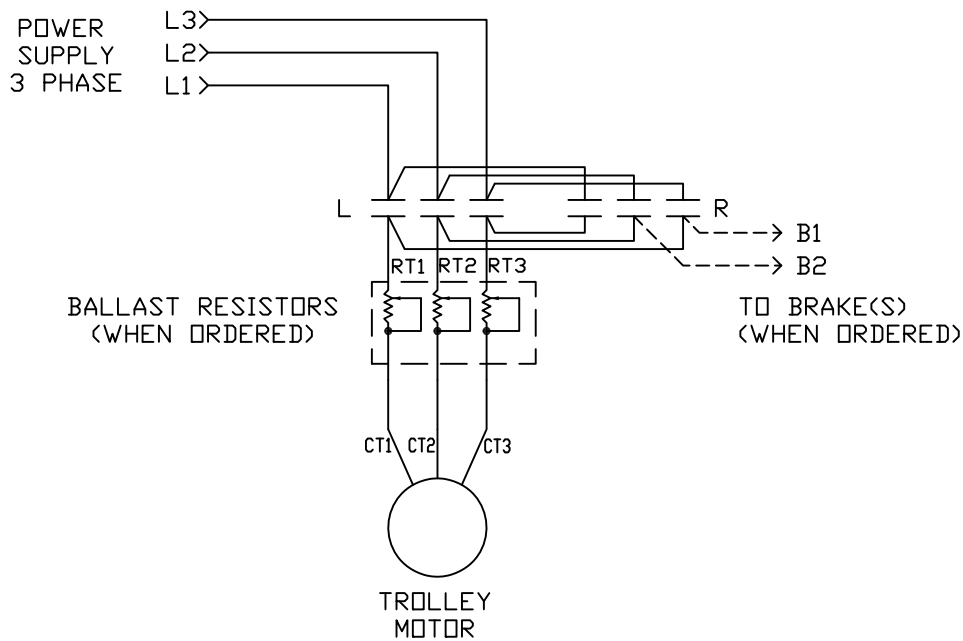

WARNING:

THIS EQUIPMENT MUST BE EFFECTIVELY GROUNDED ACCORDING TO APPLICABLE CODES.



AVERTISSEMENT:

CET EQUIPEMENT DOIT ETRE MIS A LA TERRE EN ACCORDANCE AVEC LES NORMES EN VIGUEUR.

TAS TEMPERATURE ACTUATED SWITCH



Y80/800 SERIES
& 700 SERIES SIZE 2 & 3
1-SPEED TROLLEY

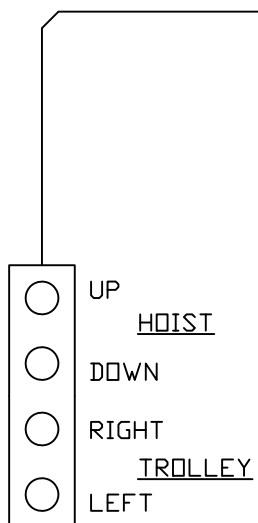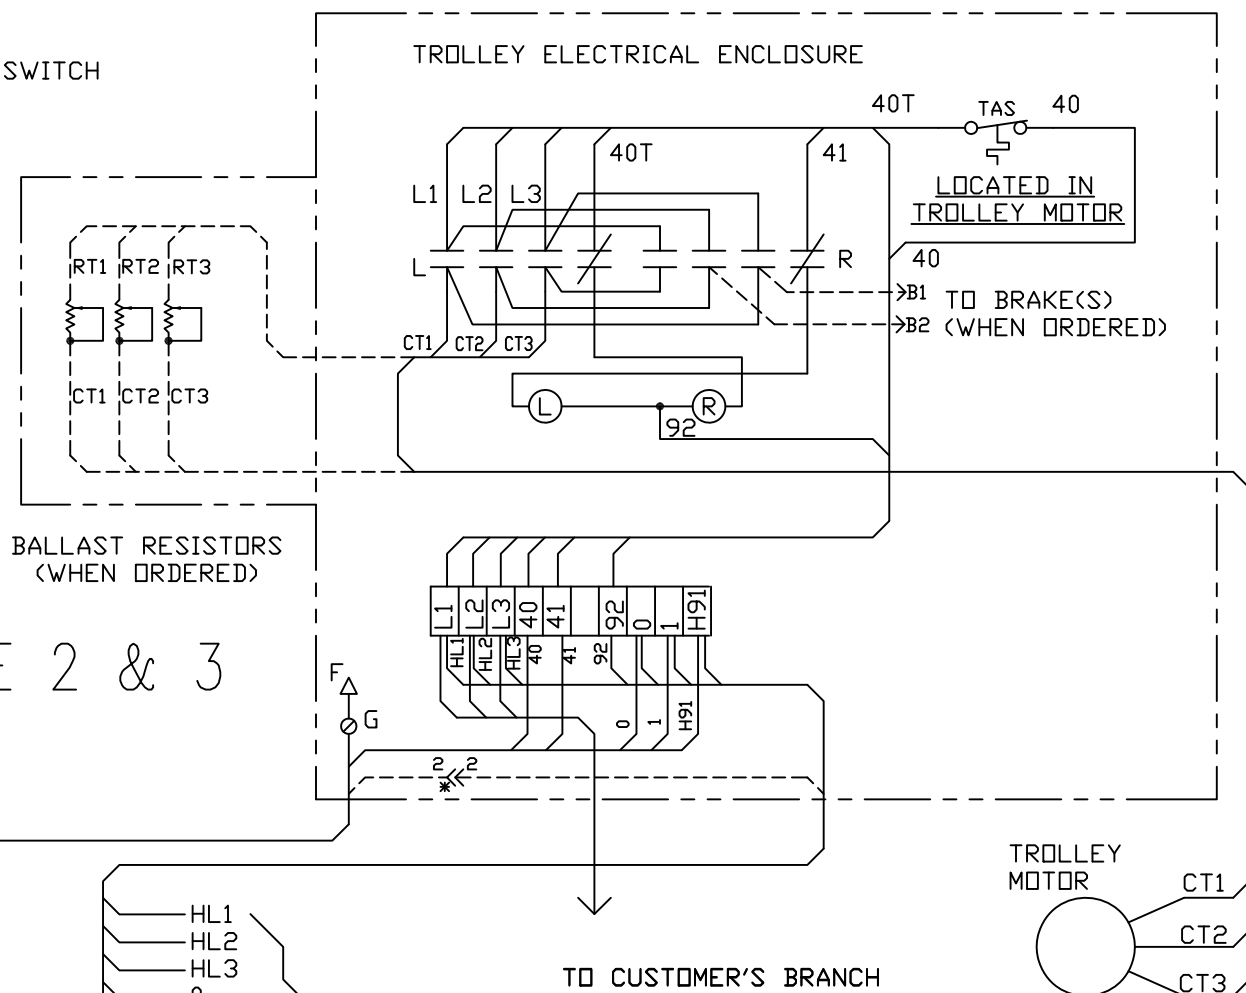

PUSHBUTTON STATION

*WIRE "2" IS USED WITH 2 SPEED HOISTS ONLY. ON SINGLE SPEED HOISTS, ISOLATE WIRE "2".

VERIFY MOTOR CONNECTIONS PER NAMEPLATE AND CONNECTION DIAGRAM PARALLEL 2ND MOTOR POWER LEADS WHEN (WHEN UTILIZED). SERIES 2nd MOTOR TAS LEADS (WHEN UTIL.)

FIRST USED ON: _____

FROM: 329047

NO.	CHANGE	DATE	ITL.	WIRING DIAGRAM- TROLLEY
2	REDRAWN ON ACAD	11/89	BES	CONTROL 3PHASE A.C.
				MONORAIL TROLLEY
				SC. -----
				DA. 11/21/89
				DR. B.E.S.
				CK.



451222

SHEET 51 OF 99 SHEETS

